



Addendum No. 1
June 22, 2023

Tri-Cities CIC Building New Gender Inclusive Restrooms
Washington State University
Richland, WA

Project No.1907-2023
Washington State University
Facilities Services, Capital

**Addendum No.1
June 22, 2023****Tri-Cities CIC Building New Gender Inclusive Restrooms
Washington State University
Richland, WA****Bid Date: July 11, 2023**

1. This Addendum forms a part of the Contract Documents and modifies the original Bidding Documents dated June 15, 2023, and any prior addenda, as noted below.
2. Please acknowledge receipt of this addendum on the Form of Proposal.

This Addendum consists of thirty-one total pages including the following Attachments:

000110 - Table of Contents
Attachment A: Good Faith Hazardous Material Survey

Changes to prior Addenda: N/A**Changes to Bidding Requirements: None****Changes to Specifications:****SP 1-1. SECTION 00 01 10 – Table of Contents**

- | | | |
|---------|-------------|---|
| Item 1. | <i>Add:</i> | <i>Replace in its entirety Section 00 01 10 – Table of Contents</i> |
| Item 2. | <i>Add:</i> | 00 72 00 General Conditions for Washington State Facilities Construction with Washington State University Amendments
<i>Attachment A: Good Faith Hazardous Material Survey</i> |

Changes to Drawings: None**END OF ADDENDUM No.1**

CONDITIONS OF THE CONTRACT

00 11 13	Advertisement for Bids
00 21 13	Instructions to Bidders
00 42 13	Form of Proposal: Base Bid & Alternate Bids
00 50 00	Agreement between Owner and Contractor
00 72 00	General Conditions for Washington State Facilities Construction with Washington State University Amendments
	Attachment A: Good Faith Hazardous Material Survey
00 80 10	Third Party Neutral

DIVISION 01 GENERAL REQUIREMENTS

01 11 00	Summary of Work
01 26 00	Change Order Procedures
01 29 00	Applications for Payment
	Current Prevailing Wage Rates
01 29 73	Schedule of Values
01 31 19	Project Meetings
01 31 23	Coordination
01 32 13	Progress Schedule
01 32 33	Construction Photographs
01 33 00	Submittals
01 35 16	Alteration Procedures
01 41 00	Regulatory Requirements
01 41 19	Special Provisions
01 45 00	Quality Control
01 45 23	Testing Laboratory Services
01 45 34	Contract Performance Evaluation Program
01 50 00	Construction Facilities & Temporary Controls
01 60 00	Material and Equipment
01 70 00	Project Close-Out
01 71 23	Field Engineering
01 74 19	Construction Waste Management
01 78 23	Operation & Maintenance Manuals
01 78 39	Project Record
01 81 19	Indoor Air Quality Management Plan
01 91 00	Commissioning Requirements

DIVISION 05 METALS

05 40 00	Cold-Formed Metal Framing
----------	---------------------------

DIVISION 06 WOOD, PLASTICS, AND COMPOSITES

06 40 20	Interior Architectural Woodwork
----------	---------------------------------

DIVISION 07 THERMAL AND MOISTURE PROTECTION

07 21 00	Building Insulation
----------	---------------------

07 72 00 Roof Accessories
07 92 00 Joint Sealants

DIVISION 08 DOORS AND WINDOWS

08 11 00 Steel Door Frames
08 21 10 Flush Wood Doors
08 71 00 Door Hardware
08 83 00 Mirrors

DIVISION 09 FINISHES

09 00 01 Finish Schedule
09 26 00 Gypsum Board Assemblies
09 31 00 Ceramic Tile
09 51 10 Acoustical Ceiling Panels
09 66 00 Resilient Flooring
09 91 20 Interior Painting

DIVISION 10 SPECIALTIES

10 26 50 Impact-Resistant Wall Protection
10 43 10 Signage
10 80 10 Toilet and, Bath Accessories

DIVISION 21 FIRE SUPPRESSION

21 13 14 Wet Sprinkler Systems

DIVISION 22 PLUMBING

22 05 17 Sleeves and Seals
22 05 93 Tasting adjusting and Balancing
22 07 00 Insulation
22 11 16 Domestic Water Piping
22 13 16 Sanitary Waste and Vent Piping
22 40 00 Plumbing fixtures

DIVISION 23 HEATING VENTILATING AND AIR CONDITIONING

23 31 13 Ducts
23 33 00 Duct Accessories
23 37 13 Diffusers, Registers and Grilles

DIVISION 26 ELECTRICAL

26 05 11 Requirements for Electrical Installations
26 05 19 Low Voltage Electrical Power Conductors and Cables
26 05 26 Grounding and Bonding
26 05 33 Raceways and Boxes
26 27 26 Wiring Devices

26 51 00 Interior Lighting

DIVISION 28 ELECTRONIC SAFETY AND SECURITY

28 31 00 Fire Detection and Alarm

END OF SECTION 00 01 10

Limited Good Faith Inspection for Asbestos
WSU Tri-Cities CIC Building – 2nd Floor Restroom Project
June 2023

Purpose

This inspection was performed to determine if asbestos-containing materials are present in the walls of the Consolidated Information Center (CIC) Building prior to work requiring any demolition or disturbance of walls in the building. The inspection was limited to ceiling and miscellaneous materials expected to be impacted by renovations adding a restroom to the second floor of the library.

Inspection Methods

The inspection was performed on June 7, 2023, and included portions of the existing server room (225B), computer center shop (225A) and the northeast corner of the library (201). Bulk samples of suspect asbestos-containing materials (ACM) were collected by Scott Tomren, a certified AHERA building inspector. No significant differences were noted between materials sampled, and the entire area was treated as a single homogenous area. Sample locations were selected randomly within the area. Samples were collected of the suspended ceiling tile and the floor tile (white and black vinyl). Single samples of fibrous insulation and of cove base molding & mastic were collected, as these materials were encountered in limited portions of the project area.

Sampling tools were cleaned between each use. Samples were sealed in individual Ziploc bags and labeled with a sample number for analysis. Sample numbers included reference to the building, the date, and the individual sample. For example, sample number CIC-23-01 represents the first sample (01) collected in 2023 (23) from the CIC Building (CIC). A letter designation was added when multiple samples were collected of similar materials.

Upon completion of sampling, all samples were sent to NVL Laboratories in Seattle, a NVLAP-accredited laboratory, for analysis by polarized light microscopy (PLM).

Results

Analysis indicates that none of the 11 samples collected contains detectable quantities of asbestos. Based on these results, projects impacting the identified materials within the inspection area will not be considered asbestos projects.

Details regarding sample locations and results are attached. A copy of this information should be provided to any contractor(s) performing projects in the inspection area.

Previous Results

Inspection and sampling of walls in the CIC building was performed in March 2021. Results of that inspection are attached as an appendix to this report.

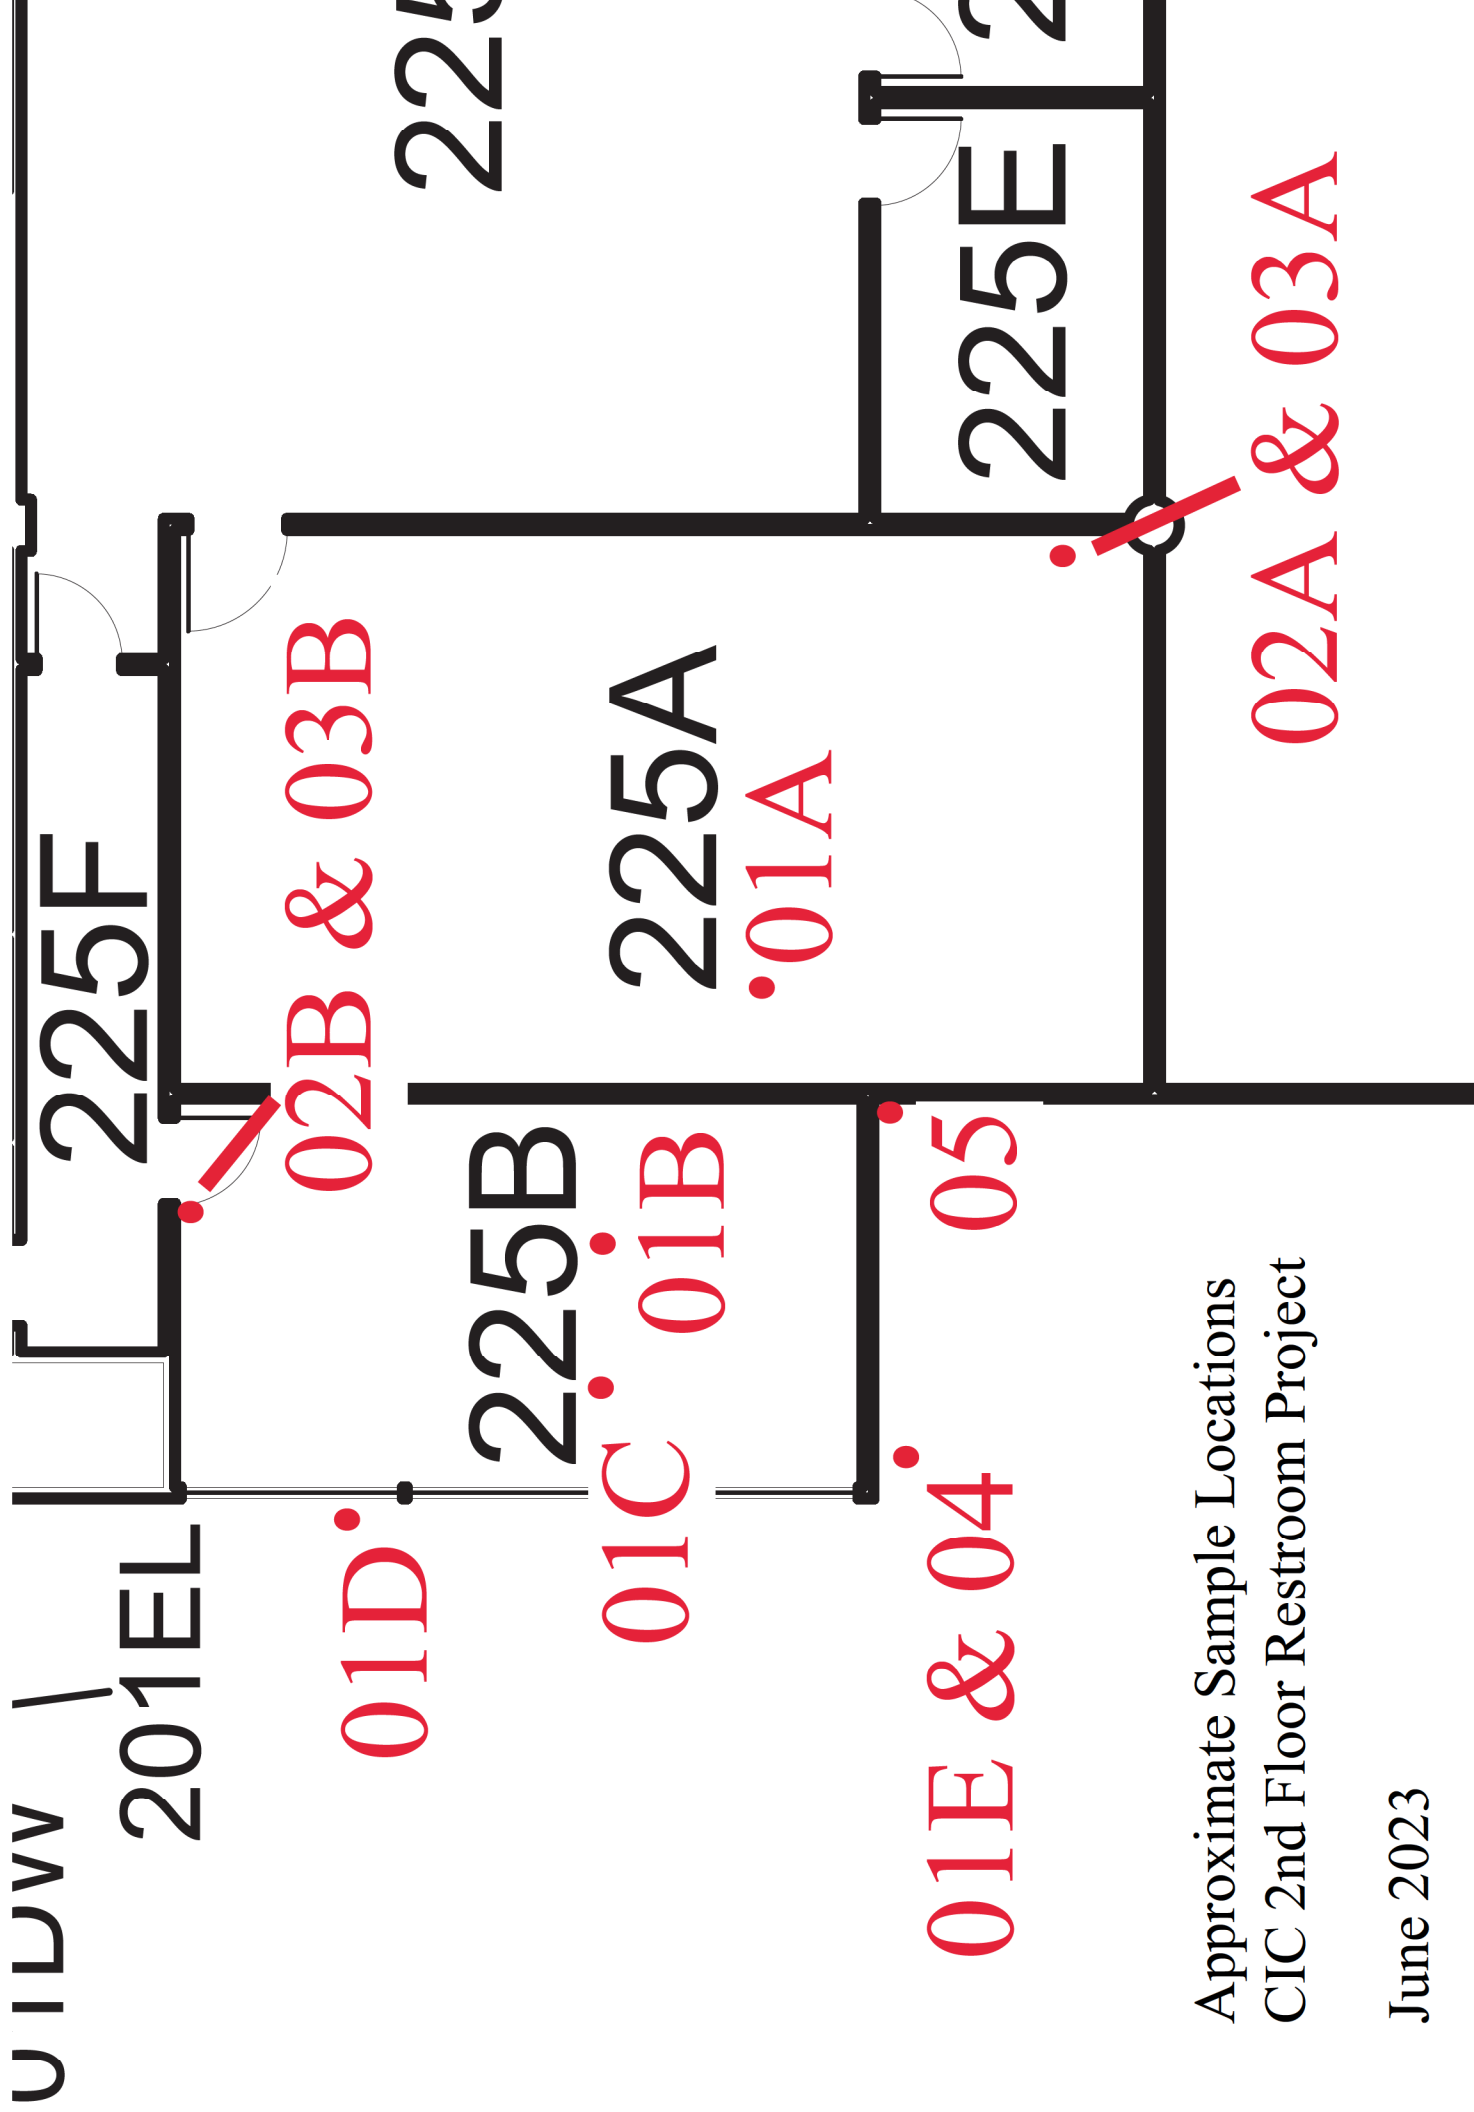


Scott Tomren

Building Inspector Cert #186861, Exp. 11/16/2023 (Trainer: Argus Pacific)

Limited Good Faith Inspection for Asbestos
WSU Tri-Cities CIC Building – 2nd Floor Restroom Project
June 2023

Sample number	Location	Result
CIC-23-01A	Ceiling tile, west side of 225A	ND (1 layer)
CIC-23-01B	Ceiling tile, east side of 225B	ND (1 layer)
CIC-23-01C	Ceiling tile, west side of 225B	ND (1 layer)
CIC-23-01D	Ceiling tile, east wall of library 2 nd floor	ND (1 layer)
CIC-23-01E	Ceiling tile, near SW corner of project area	ND (1 layer)
CIC-23-02A	White floor tile, SE corner of 225A	ND (2 layers)
CIC-23-02B	White floor tile, bottom of 225B door frame	ND (2 layers)
CIC-23-03A	Black floor tile, SE corner of 225A	ND (2 layers)
CIC-23-03B	Black floor tile, bottom of 225B door frame	ND (2 layers)
CIC-23-04	Black fibrous insulation found above ceiling tile at location CIC-23-01E	ND (1 layers)
CIC-23-05	Grey cove base molding w/ white mastic, SE corner of project area	ND (2 layers)



Approximate Sample Locations
CIC 2nd Floor Restroom Project

June 2023

June 13, 2023



Scott Tomren
WSU Tri-Cities
2710 Crimson Way
Richland, WA 99354

RE: Bulk Asbestos Fiber Analysis; NVL Batch # 2309156.00

Client Project: CIC
Location: Server Room

Dear Mr. Tomren,

Enclosed please find test results for the 11 sample(s) submitted to our laboratory for analysis on 6/9/2023.

Examination of these samples was conducted for the presence of identifiable asbestos fibers using polarized light microscopy (PLM) with dispersion staining in accordance with **U. S. EPA 40 CFR Appendix E to Subpart E of Part 763**, Interim Method for the Determination of Asbestos in Bulk Insulation Samples and **EPA 600/R-93/116**, Method for the Determination of Asbestos in Bulk Building Materials.

For samples containing more than one separable layer of materials, the report will include findings for each layer (labeled Layer 1 and Layer 2, etc. for each individual layer). The asbestos concentration in the sample is determined by calibrated visual estimation.

For those samples with asbestos concentrations between 1 and 10 percent based on visual estimation, the EPA recommends a procedure known as point counting (NESHAPS, 40 CFR Part 61). Point counting is a statistically more accurate means of quantification for samples with low concentrations of asbestos.

The detection limit for the calibrated visual estimation is <1%, 400 point counts is 0.25% and 1000 point counts is 0.1%

Samples are archived for two weeks following analysis. Samples that are not retrieved by the client are discarded after two weeks.

Thank you for using our laboratory services. Please do not hesitate to call if there is anything further we can assist you with.

Sincerely,

A handwritten signature in dark ink that reads "Kunga Woser".

Kunga Woser, Senior Laboratory Analyst

The logo for NVLAP (National Voluntary Laboratory Accreditation Program). It features the letters "NVLAP" in a large, stylized, outlined font. Below the letters, the word "Testing" is written in a smaller, sans-serif font.

Lab Code: 102063-0

Enc.: Sample Results

Phone: 206 547.0100 | Fax: 206 634.1936 | Toll Free: 1.888.NVL.LABS (685.5227)
4708 Aurora Avenue North | Seattle, WA 98103-6516



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: WSU Tri-Cities
Address: 2710 Crimson Way
Richland, WA 99354

Attention: Mr. Scott Tomren
Project Location: Server Room

Batch #: 2309156.00

Client Project #: CIC
Date Received: 6/9/2023
Samples Received: 11
Samples Analyzed: 11
Method: EPA/600/R-93/116

Lab ID: 23055905 **Client Sample #: CIC-23-01A**

Location: Server Room

Layer 1 of 1 **Description:** Gray fibrous material with paint

Non-Fibrous Materials:	Other Fibrous Materials:%
Binder/Filler, Paint, Glass debris	Glass fibers 53%
	Cellulose 31%

Asbestos Type: %
None Detected ND

Lab ID: 23055906 **Client Sample #: CIC-23-01B**

Location: Server Room

Layer 1 of 1 **Description:** Gray fibrous material with paint

Non-Fibrous Materials:	Other Fibrous Materials:%
Binder/Filler, Paint, Glass debris	Glass fibers 51%
	Cellulose 34%

Asbestos Type: %
None Detected ND

Lab ID: 23055907 **Client Sample #: CIC-23-01C**

Location: Server Room

Layer 1 of 1 **Description:** Gray fibrous material with paint

Non-Fibrous Materials:	Other Fibrous Materials:%
Binder/Filler, Paint, Glass debris	Glass fibers 52%
	Cellulose 32%

Asbestos Type: %
None Detected ND

Lab ID: 23055908 **Client Sample #: CIC-23-01D**

Location: Server Room

Layer 1 of 1 **Description:** Gray fibrous material with paint

Non-Fibrous Materials:	Other Fibrous Materials:%
Binder/Filler, Paint, Glass debris	Glass fibers 53%
	Cellulose 31%

Asbestos Type: %
None Detected ND

Sampled by: Client

Analyzed by: Alex Shea

Reviewed by: Kunga Woser

Date: 06/13/2023

Date: 06/13/2023

Kunga Woser

Kunga Woser, Senior Laboratory Analyst

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and EPA 40 CFR Appendix E to Subpart E of Part 763 with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: WSU Tri-Cities

Address: 2710 Crimson Way
Richland, WA 99354

Batch #: 2309156.00

Client Project #: CIC

Date Received: 6/9/2023

Samples Received: 11

Samples Analyzed: 11

Method: EPA/600/R-93/116

Attention: Mr. Scott Tomren

Project Location: Server Room

Lab ID: 23055909 **Client Sample #: CIC-23-01E**

Location: Server Room

Layer 1 of 1 **Description:** Gray fibrous material with paint

Non-Fibrous Materials:	Other Fibrous Materials:%
Binder/Filler, Paint, Glass debris	Glass fibers 52%
	Cellulose 33%

Asbestos Type: %
None Detected ND

Lab ID: 23055910 **Client Sample #: CIC-23-02A**

Location: Server Room

Layer 1 of 2 **Description:** Gray vinyl tile

Non-Fibrous Materials:	Other Fibrous Materials:%
Vinyl/Binder, Fine grains	None Detected ND

Asbestos Type: %
None Detected ND

Layer 2 of 2 **Description:** Tan brittle mastic

Non-Fibrous Materials:	Other Fibrous Materials:%
Mastic/Binder, Fine particles	None Detected ND

Asbestos Type: %
None Detected ND

Lab ID: 23055911 **Client Sample #: CIC-23-02B**

Location: Server Room

Layer 1 of 2 **Description:** Gray vinyl tile

Non-Fibrous Materials:	Other Fibrous Materials:%
Vinyl/Binder, Fine grains	None Detected ND

Asbestos Type: %
None Detected ND

Layer 2 of 2 **Description:** Tan brittle mastic

Non-Fibrous Materials:	Other Fibrous Materials:%
Mastic/Binder, Fine particles	None Detected ND

Asbestos Type: %
None Detected ND

Lab ID: 23055912 **Client Sample #: CIC-23-03A**

Location: Server Room

Sampled by: Client

Analyzed by: Alex Shea

Reviewed by: Kunga Woser

Date: 06/13/2023

Date: 06/13/2023

Kunga Woser

Kunga Woser, Senior Laboratory Analyst

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and EPA 40 CFR Appendix E to Subpart E of Part 763 with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: WSU Tri-Cities
Address: 2710 Crimson Way
Richland, WA 99354

Attention: Mr. Scott Tomren
Project Location: Server Room

Batch #: 2309156.00

Client Project #: CIC
Date Received: 6/9/2023
Samples Received: 11
Samples Analyzed: 11
Method: EPA/600/R-93/116

Layer 1 of 2	Description: Black vinyl tile	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
		Vinyl/Binder, Fine grains	None Detected ND	
Layer 2 of 2	Description: Tan brittle mastic	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
		Mastic/Binder, Fine particles	Cellulose <1%	
Lab ID: 23055913 Client Sample #: CIC-23-03B				
Location: Server Room				
Layer 1 of 2	Description: Black vinyl tile	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
		Vinyl/Binder, Fine grains	None Detected ND	
Layer 2 of 2	Description: Tan brittle mastic	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
		Mastic/Binder, Fine particles	Cellulose <1%	
Lab ID: 23055914 Client Sample #: CIC-23-04				
Location: Server Room				
Layer 1 of 1	Description: Gray loose fibrous material	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
		Binder/Filler, Glass debris	Glass fibers 92%	
Lab ID: 23055915 Client Sample #: CIC-23-05				
Location: Server Room				
Layer 1 of 2	Description: Gray rubbery material	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
		Rubber/Binder, Fine particles	None Detected ND	

Sampled by: Client

Analyzed by: Alex Shea

Reviewed by: Kunga Woser

Date: 06/13/2023

Date: 06/13/2023

Kunga Woser

Kunga Woser, Senior Laboratory Analyst

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and EPA 40 CFR Appendix E to Subpart E of Part 763 with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: WSU Tri-Cities

Address: 2710 Crimson Way
Richland, WA 99354

Attention: Mr. Scott Tomren

Project Location: Server Room

Batch #: 2309156.00

Client Project #: CIC

Date Received: 6/9/2023

Samples Received: 11

Samples Analyzed: 11

Method: EPA/600/R-93/116

Layer 2 of 2

Description: White brittle mastic

Non-Fibrous Materials:

Mastic/Binder, Fine particles

Other Fibrous Materials: %

Glass fibers 4%

Asbestos Type: %

None Detected ND

Sampled by: Client

Analyzed by: Alex Shea

Reviewed by: Kunga Woser

Date: 06/13/2023

Date: 06/13/2023

Kunga Woser

Kunga Woser, Senior Laboratory Analyst

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and EPA 40 CFR Appendix E to Subpart E of Part 763 with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government

ASBESTOS LABORATORY SERVICES



Company WSU Tri-Cities
Address 2710 Crimson Way
 Richland, WA 99354
Project Manager Mr. Scott Tomren
Phone (509) 372-7163
NVL Batch Number 2309156.00
TAT 3 Days **AH** No
Rush TAT
Due Date 6/14/2023 **Time** 9:00 AM
Email stomren@wsu.edu
Fax

Project Name/Number: CIC **Project Location:** Server Room

Subcategory PLM Bulk
Item Code ASB-02 **EPA 600/R-93-116 Asbestos by PLM <bulk>**

Total Number of Samples 11 **Rush Samples**

	Lab ID	Sample ID	Description	A/R
1	23055905	CIC-23-01A		A
2	23055906	CIC-23-01B		A
3	23055907	CIC-23-01C		A
4	23055908	CIC-23-01D		A
5	23055909	CIC-23-01E		A
6	23055910	CIC-23-02A		A
7	23055911	CIC-23-02B		A
8	23055912	CIC-23-03A		A
9	23055913	CIC-23-03B		A
10	23055914	CIC-23-04		A
11	23055915	CIC-23-05		A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Federal Express				

Office Use Only	Print Name	Signature	Company	Date	Time
Received by	Kelly AuVu		NVL	6/9/23	900
Analyzed by	Alex Shea		NVL	6/13/23	
Results Called by					
☐ Faxed ☐ Emailed					

Special Instructions:

Date: 6/9/2023
 Time: 9:27 AM
 Entered By: Kelly AuVu

2309156



ASBESTOS CHAIN OF CUSTODY

Turn Around Time

- ☐ 1 Hour ☐ 24 Hours ☐ 4 Days
☐ 2 Hours ☐ 2 Days ☐ 5 Days
☐ 4 Hours ☒ 3 Days ☐ 10 Days

Please call for TAT less than 24 Hours

Company WSU Tri-Cities
 Address 2710 Crimson Way
Richland, WA 99354
 Phone 509-372-7163

Project Manager Scott Tomren
 Cell () -
 Email stomren@wsu.edu
 Fax () -

Project Name/Number CIC	Project Location Server Room
--------------------------------	-------------------------------------

☐ PCM Air (NIOSH 7400) ☐ TEM (NIOSH 7402) ☐ TEM (AHERA) ☐ TEM (EPA Level II Modified)
☒ PLM (EPA 600/R-93-116) ☐ EPA 400 Points (600/R-93-116) ☐ EPA 1000Points (600/R-93-116)
☐ PLM Gravimetry (600/R-93-116) ☐ Asbestos in Vermiculite (EPA 600/R-04/004) ☐ Asbestos in Sediment (EPA 1900 Points)
☐ Asbestos Friable/Non-Friable (EPA 600/R-93/116) ☐ Other _____

Reporting Instructions

☐ Call () -
☐ Fax () -
☐ Email _____

Total Number of Samples 11

	Sample ID	Description	A/R
1	CIC -23-01A	Spongy off-white material	
2	CIC-23-01B	Spongy off-white material	
3	CIC-23-01c	Spongy off-white material	
4	CIC-23-01D	Spongy off-white material	
5	CIC-23-01E	Spongy off-white material	
6	CIC-23-02A	White VFT	
7	CIC-23-02B	White VFT	
8	CIC-23-03A	Black VFT	
9	CIC-23-03B	Black VFT	
10	CIC-23-04	Black fibrous insulating material	
11	CIC-23-05	Grey rubber w/ spots of mastic	
12			
13			
14			
15			

PAID
6/9/23

	Print Name	Signature	Company	Date	Time
Sampled by	S. Tomren		WSUTC	6/7/2023	1500
Relinquish by	S. Tomren		WSUTC	6/7/2023	1500

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	Keun Achen		nu	6/9/23	9:00 AM
Analyzed by					
Called by					
Faxed/Email by					

Limited Good Faith Inspection for Asbestos
WSU Tri-Cities CIC Building
March 2021

Purpose

This inspection was performed to determine if asbestos-containing materials are present in the walls of the Consolidated Information Center (CIC) Building prior to work requiring any demolition or disturbance of walls in the building. The inspection was limited to wall materials on the first and second floor, and does not include moveable walls.

Inspection Methods

The inspection was performed on February 26, 2021, and included the first and second floors of the CIC Building. Bulk samples of suspect asbestos-containing materials (ACM) were collected by Scott Tomren, a certified AHERA building inspector. Each floor was treated as a separate homogenous area for sampling purposes, however no significant differences were noted between materials sampled. Sample locations were selected randomly, with nine sample locations distributed throughout each floor of the building.¹ As no demolition is currently planned, most samples were located above the suspended ceiling in order to minimize visual impact. This also made it possible to maximize the number of samples containing quantities of joint compound and/or tape in addition to the drywall material.

Full-thickness samples of wall materials (including drywall, tape, and joint compound) were collected at each location using cork borers. Sampling tools were cleaned between each use. Samples were sealed in individual Ziploc bags and labeled with a sample number for analysis. Sample numbers included reference to the building and floor, the date, and the individual sample. For example, sample number CIC1-21-01 represents the first sample (01) collected in 2021 (21) from the first floor of the CIC Building (CIC1). Each sample location was labeled with the corresponding sample number, and was sealed with adhesive following sample collection.

Upon completion of sampling, all samples were sent to NVL Laboratories in Seattle, a NVLAP-accredited laboratory, for analysis by polarized light microscopy (PLM).

Results

Analysis indicates that none of the 18 samples collected contains detectable quantities of asbestos. Based on these results, projects impacting the walls within the inspection area will not be considered asbestos projects.

Details regarding sample locations and results are attached. A copy of this information should be provided to any contractor(s) performing projects in the inspection area.

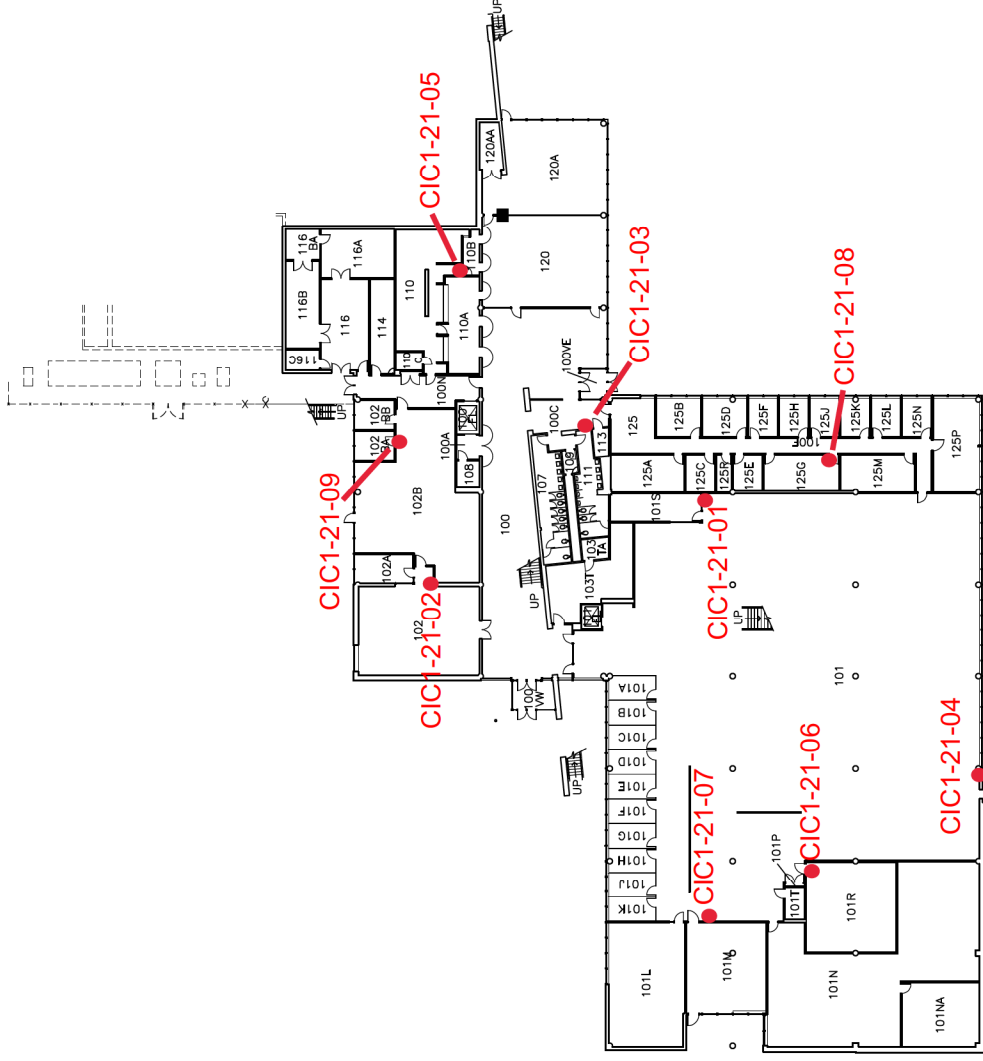


Scott Tomren
Building Inspector Cert #177822, Exp. 4/10/2021 (Trainer: Argus Pacific)

¹ Drywall materials are typically considered miscellaneous material under AHERA, and multiple samples are not required. Joint compound and tape are considered “finishing material”, and also do not require multiple samples, except in cases where they are applied to the entire surface of the wall. However, based on uncertainty regarding the uniformity of materials used, and the relatively large quantity of material, multiple samples of wall materials were collected using criteria typically applied to surfacing materials under AHERA.

**Limited Good Faith Inspection for Asbestos
WSU Tri-Cities CIC Building
March 2021**

Sample number	Location	Result
CIC1-21-01	Northeast corner of library, outside room 101S	ND (2 layers)
CIC1-21-02	Southwest corner of alcove outside 102A	ND (3 layers)
CIC1-21-03	West wall of lobby 100C, above water fountain	ND (3 layers)
CIC1-21-04	South wall of library, near emergency exit, adjacent to concrete support column	ND (3 layers)
CIC1-21-05	Kitchen area, above door to 110B	ND (3 layers)
CIC1-21-06	Northeast corner of 101R, above doorway	ND (2 layers)
CIC1-21-07	West wall of library, south of door to 101M	ND (3 layers)
CIC1-21-08	East wall of 125G, above doorway	ND (1 layer)
CIC1-21-09	Above doorway to 102BA	ND (2 layers)
CIC2-21-01	East wall of 225C, north of door to 225CA	ND (2 layers)
CIC2-21-02	East wall of library, south of door to 201AG	ND (2 layers)
CIC2-21-03	West wall of 201C, above door	ND (2 layers)
CIC2-21-04	Northwest portion of library, between northernmost concrete columns	ND (2 layers)
CIC2-21-05	East wall of 216 entryway	ND (2 layers)
CIC2-21-06	North wall, northeast corner of 214	ND (2 layers)
CIC2-21-07	North wall of 200A lobby, near elevator	ND (2 layers)
CIC2-21-08	Southwest corner of 221, just north of concrete column	ND (2 layers)
CIC2-21-09	202A, middle of wall separating from 206	ND (2 layers)



FIRST FLOOR PLAN

BUILDING SQUARE FOOTAGE	
FIRST FLOOR	40,911
SECOND FLOOR	32,878
MECH. PENTHOUSE	7,521
TOTAL	81,310

GROSS SQUARE FEET	
40,911	

BLDG. TOTAL: 81,310 S.F.

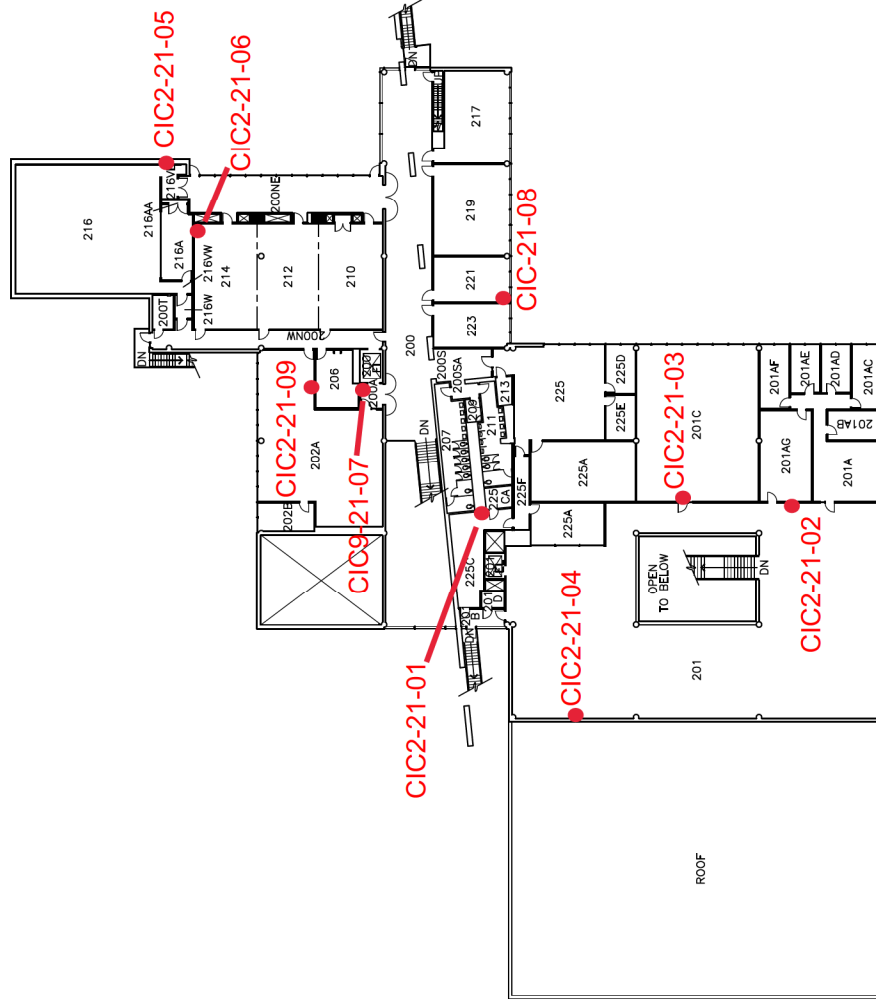
REVISION DATES	
11-10-98	
07-28-2000	
WSU FILE NO.	9512_R01



CONSOLIDATED INFORMATION CENTER
WSU TRI-CITIES



BLDG. NO.
9512
SHEET NO.
R-1



SECOND FLOOR PLAN

GROSS SQUARE FEET 32,878	REVISION DATES 07-28-2000	SCALE: 1" = 40' 0 5 10 20 40	CONSOLIDATED INFORMATION CENTER WSU TRI-CITIES	NORTH	WASHINGTON STATE UNIVERSITY	BLDG. NO. 9512 SHEET NO. R-2
BLDG. TOTAL: 81,310 S.F.	WSU FILE NO. 9512_R02					

March 10, 2021



Scott Tomren
WSU Tri-Cities
2710 Crimson Way
Richland, WA 99354

RE: Bulk Asbestos Fiber Analysis; NVL Batch # 2103926.00

Client Project: CIC
Location: Interior Walls

Dear Mr. Tomren,

Enclosed please find test results for the 18 sample(s) submitted to our laboratory for analysis on 3/3/2021.

Examination of these samples was conducted for the presence of identifiable asbestos fibers using polarized light microscopy (PLM) with dispersion staining in accordance with **U. S. EPA 40 CFR Appendix E to Subpart E of Part 763**, Interim Method for the Determination of Asbestos in Bulk Insulation Samples and **EPA 600/R-93/116**, Method for the Determination of Asbestos in Bulk Building Materials.

For samples containing more than one separable layer of materials, the report will include findings for each layer (labeled Layer 1 and Layer 2, etc. for each individual layer). The asbestos concentration in the sample is determined by calibrated visual estimation.

For those samples with asbestos concentrations between 1 and 10 percent based on visual estimation, the EPA recommends a procedure known as point counting (NESHAPS, 40 CFR Part 61). Point counting is a statistically more accurate means of quantification for samples with low concentrations of asbestos.

The detection limit for the calibrated visual estimation is <1%, 400 point counts is 0.25% and 1000 point counts is 0.1%

Samples are archived for two weeks following analysis. Samples that are not retrieved by the client are discarded after two weeks.

Thank you for using our laboratory services. Please do not hesitate to call if there is anything further we can assist you with.

Sincerely,


Evelyn Ahulu, EM Lab Manager



Enc.: Sample Results

Phone: 206 547.0100 | Fax: 206 634.1936 | Toll Free: 1.888.NVL.LABS (685.5227)
4708 Aurora Avenue North | Seattle, WA 98103-6516



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: WSU Tri-Cities
Address: 2710 Crimson Way
Richland, WA 99354

Batch #: 2103926.00

Client Project #: CIC

Date Received: 3/3/2021

Samples Received: 18

Samples Analyzed: 18

Method: EPA/600/R-93/116

Attention: Mr. Scott Tomren

Project Location: Interior Walls

Lab ID: 21030629 **Client Sample #: CIC1-21-1**

Location: Interior Walls

Layer 1 of 2 **Description:** White compacted powdery material with paint

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Calcareous binder, Calcareous particles, Paint	Cellulose <1%	None Detected ND

Layer 2 of 2 **Description:** Off-white chalky material with paper

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Gypsum/Binder	Cellulose 25%	None Detected ND
	Glass fibers 2%	

Lab ID: 21030630 **Client Sample #: CIC1-21-2**

Location: Interior Walls

Layer 1 of 3 **Description:** White compacted powdery material with paint

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Calcareous binder, Calcareous particles, Paint	None Detected ND	None Detected ND

Layer 2 of 3 **Description:** Off-white compacted powdery material with paper

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Calcareous binder, Asphaltic Particles	Cellulose 50%	None Detected ND

Layer 3 of 3 **Description:** Off-white chalky material with paper

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Gypsum/Binder	Cellulose 30%	None Detected ND
	Glass fibers 2%	

Lab ID: 21030631 **Client Sample #: CIC1-21-3**

Location: Interior Walls


Sampled by: Client

Analyzed by: Nick Ly

Reviewed by: Evelyn Ahulu

Date: 03/10/2021

Date: 03/10/2021


Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: WSU Tri-Cities
Address: 2710 Crimson Way
Richland, WA 99354

Attention: Mr. Scott Tomren
Project Location: Interior Walls

Batch #: 2103926.00

Client Project #: CIC
Date Received: 3/3/2021
Samples Received: 18
Samples Analyzed: 18
Method: EPA/600/R-93/116

Layer 1 of 3	Description: White compacted powdery material	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
		Calcareous binder, Calcareous particles	None Detected ND	
Layer 2 of 3	Description: White compacted powdery material with paper	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
		Calcareous binder, Calcareous particles	Cellulose 55%	
Layer 3 of 3	Description: Peach chalky material with paper	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
		Gypsum/Binder	Cellulose 20%	
			Glass fibers 3%	

Lab ID: 21030632 **Client Sample #: CIC1-21-4**

Location: Interior Walls

Layer 1 of 3	Description: White compacted powdery material with paint	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
		Calcareous binder, Calcareous particles, Paint	None Detected ND	
Layer 2 of 3	Description: White compacted powdery material with paper	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
		Calcareous binder, Calcareous particles	Cellulose 3%	
Layer 3 of 3	Description: Off-white chalky material with paper	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
		Gypsum/Binder	Cellulose 28%	
			Glass fibers 2%	

Lab ID: 21030633 **Client Sample #: CIC1-21-5**

Location: Interior Walls


Sampled by: Client

Analyzed by: Nick Ly

Reviewed by: Evelyn Ahulu

Date: 03/10/2021

Date: 03/10/2021


Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: WSU Tri-Cities
Address: 2710 Crimson Way
Richland, WA 99354

Attention: Mr. Scott Tomren
Project Location: Interior Walls

Batch #: 2103926.00

Client Project #: CIC
Date Received: 3/3/2021
Samples Received: 18
Samples Analyzed: 18
Method: EPA/600/R-93/116

Layer 1 of 3	Description: White compacted powdery material	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
	Calcareous binder, Calcareous particles		Cellulose <1%	None Detected ND
Layer 2 of 3	Description: White compacted powdery material with paper	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
	Calcareous binder, Calcareous particles		Cellulose 2%	None Detected ND
Layer 3 of 3	Description: Off-white chalky material with paper	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
	Gypsum/Binder		Cellulose 25%	None Detected ND
			Glass fibers 3%	

Lab ID: 21030634 **Client Sample #: CIC1-21-6**

Location: Interior Walls

Layer 1 of 2	Description: White compacted powdery material with paint	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
	Calcareous binder, Calcareous particles, Paint		None Detected ND	None Detected ND
Layer 2 of 2	Description: Off-white chalky material with paper	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
	Gypsum/Binder		Cellulose 30%	None Detected ND
			Glass fibers 2%	

Lab ID: 21030635 **Client Sample #: CIC1-21-7**

Location: Interior Walls

Layer 1 of 3	Description: White compacted powdery material with paint	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
	Calcareous binder, Calcareous particles, Paint		None Detected ND	None Detected ND


Sampled by: Client

Analyzed by: Nick Ly

Reviewed by: Evelyn Ahulu

Date: 03/10/2021

Date: 03/10/2021


Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: WSU Tri-Cities
Address: 2710 Crimson Way
Richland, WA 99354

Attention: Mr. Scott Tomren
Project Location: Interior Walls

Batch #: 2103926.00

Client Project #: CIC
Date Received: 3/3/2021
Samples Received: 18
Samples Analyzed: 18
Method: EPA/600/R-93/116

Layer 2 of 3	Description: White compacted powdery material with paper	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
		Calcareous binder, Calcareous particles	Cellulose 3%	
Layer 3 of 3	Description: Off-white chalky material with paper	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
		Gypsum/Binder	Cellulose 30%	
			Glass fibers 3%	

Lab ID: 21030636 **Client Sample #: CIC1-21-8**

Location: Interior Walls

Layer 1 of 1	Description: Off-white chalky material with paper and paint	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
		Gypsum/Binder, Paint	Cellulose 35%	
			Glass fibers 4%	

Lab ID: 21030637 **Client Sample #: CIC1-21-9**

Location: Interior Walls

Layer 1 of 2	Description: White compacted powdery material with paper and paint	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
		Calcareous binder, Calcareous particles, Paint	Cellulose 55%	
Layer 2 of 2	Description: Off-white chalky material with paper	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
		Gypsum/Binder	Cellulose 38%	
			Glass fibers 2%	

Lab ID: 21030638 **Client Sample #: CIC2-21-1**

Location: Interior Walls

Sampled by: Client

Analyzed by: Nick Ly

Reviewed by: Evelyn Ahulu

Date: 03/10/2021

Date: 03/10/2021

Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: WSU Tri-Cities
Address: 2710 Crimson Way
Richland, WA 99354

Attention: Mr. Scott Tomren
Project Location: Interior Walls

Batch #: 2103926.00

Client Project #: CIC
Date Received: 3/3/2021
Samples Received: 18
Samples Analyzed: 18
Method: EPA/600/R-93/116

Layer 1 of 2	Description: Thin white compacted powdery material with paper and paint	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
		Calcareous binder, Calcareous particles, Paint	Cellulose 60%	
Layer 2 of 2	Description: Off-white chalky material with paper	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
		Gypsum/Binder	Cellulose 30%	
			Glass fibers 3%	

Lab ID: 21030639 **Client Sample #: CIC2-21-2**

Location: Interior Walls

Layer 1 of 2	Description: Thin white compacted powdery material with paper and paint	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
		Calcareous binder, Calcareous particles, Paint	Cellulose 55%	
Layer 2 of 2	Description: Off-white chalky material with paper	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
		Gypsum/Binder	Cellulose 28%	
			Glass fibers 2%	

Lab ID: 21030640 **Client Sample #: CIC2-21-3**

Location: Interior Walls

Layer 1 of 2	Description: Thin white compacted powdery material with paper and paint	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
		Calcareous binder, Calcareous particles, Paint	Cellulose 65%	
Layer 2 of 2	Description: Off-white chalky material with paper	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
		Gypsum/Binder	Cellulose 40%	

Sampled by: Client

Analyzed by: Nick Ly

Reviewed by: Evelyn Ahulu

Date: 03/10/2021

Date: 03/10/2021

Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: WSU Tri-Cities
Address: 2710 Crimson Way
Richland, WA 99354

Attention: Mr. Scott Tomren
Project Location: Interior Walls

Batch #: 2103926.00

Client Project #: CIC
Date Received: 3/3/2021
Samples Received: 18
Samples Analyzed: 18
Method: EPA/600/R-93/116

Glass fibers 3%

Lab ID: 21030641 **Client Sample #: CIC2-21-4**

Location: Interior Walls

Layer 1 of 2 **Description:** White compacted powdery material with paper and paint

Non-Fibrous Materials:	Other Fibrous Materials:%
Calcareous binder, Calcareous binder, Paint	Cellulose 55%

Asbestos Type: %
None Detected ND

Layer 2 of 2 **Description:** Off-white chalky material with paper

Non-Fibrous Materials:	Other Fibrous Materials:%
Gypsum/Binder	Cellulose 25%
	Glass fibers 2%

Asbestos Type: %
None Detected ND

Lab ID: 21030642 **Client Sample #: CIC2-21-5**

Location: Interior Walls

Layer 1 of 2 **Description:** White compacted powdery material with paint

Non-Fibrous Materials:	Other Fibrous Materials:%
Calcareous binder, Calcareous particles, Paint	Cellulose <1%

Asbestos Type: %
None Detected ND

Layer 2 of 2 **Description:** Off-white chalky material with paper

Non-Fibrous Materials:	Other Fibrous Materials:%
Gypsum/Binder	Cellulose 20%
	Glass fibers 3%

Asbestos Type: %
None Detected ND

Lab ID: 21030643 **Client Sample #: CIC2-21-6**

Location: Interior Walls

Layer 1 of 2 **Description:** White compacted powdery material with paper

Non-Fibrous Materials:	Other Fibrous Materials:%
Calcareous binder, Calcareous particles	Cellulose 60%

Asbestos Type: %
None Detected ND


Sampled by: Client

Analyzed by: Nick Ly

Reviewed by: Evelyn Ahulu

Date: 03/10/2021

Date: 03/10/2021


Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: WSU Tri-Cities

Address: 2710 Crimson Way
Richland, WA 99354

Attention: Mr. Scott Tomren

Project Location: Interior Walls

Batch #: 2103926.00

Client Project #: CIC

Date Received: 3/3/2021

Samples Received: 18

Samples Analyzed: 18

Method: EPA/600/R-93/116

Layer 2 of 2	Description: Off-white chalky material with paper			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Gypsum/Binder	Cellulose 35%		None Detected ND
		Glass fibers 2%		

Lab ID: 21030644 Client Sample #: CIC2-21-7

Location: Interior Walls

Layer 1 of 2	Description: White chalky material with paper			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Calcareous binder, Asphaltic Particles	Cellulose 50%		None Detected ND
Layer 2 of 2	Description: Off-white chalky material with paper			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Gypsum/Binder	Cellulose 25%		None Detected ND
		Glass fibers 2%		

Lab ID: 21030645 Client Sample #: CIC2-21-8

Location: Interior Walls

Layer 1 of 2	Description: White compacted powdery material with paper and paint			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Calcareous binder, Calcareous particles, Paint	Cellulose 50%		None Detected ND
Layer 2 of 2	Description: Off-white chalky material with paper			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Gypsum/Binder	Cellulose 25%		None Detected ND
		Glass fibers 3%		

Lab ID: 21030646 Client Sample #: CIC2-21-9

Location: Interior Walls

Sampled by: Client

Analyzed by: Nick Ly

Reviewed by: Evelyn Ahulu

Date: 03/10/2021

Date: 03/10/2021

Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: WSU Tri-Cities
Address: 2710 Crimson Way
Richland, WA 99354

Attention: Mr. Scott Tomren
Project Location: Interior Walls

Batch #: 2103926.00

Client Project #: CIC
Date Received: 3/3/2021
Samples Received: 18
Samples Analyzed: 18
Method: EPA/600/R-93/116

Layer 1 of 2	Description: White thick compacted powdery material with paint	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
		Calcareous binder, Calcareous particles, Paint	Cellulose <1%	
Layer 2 of 2	Description: White fibrous paper	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
		Calcareous particles	Cellulose 95%	

Sampled by: Client

Analyzed by: Nick Ly

Reviewed by: Evelyn Ahulu

Date: 03/10/2021

Date: 03/10/2021

Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government

ASBESTOS LABORATORY SERVICES



Company WSU Tri-Cities
Address 2710 Crimson Way
 Richland, WA 99354
Project Manager Mr. Scott Tomren
Phone (509) 372-7163

NVL Batch Number 2103926.00
TAT 5 Days **AH** No
Rush TAT
Due Date 3/10/2021 **Time** 10:25 AM
Email stomren@tricity.wsu.edu
Fax

Project Name/Number: CIC **Project Location:** Interior Walls

Subcategory PLM Bulk

Item Code ASB-02 **EPA 600/R-93-116 Asbestos by PLM <bulk>**

Total Number of Samples 18

Rush Samples

	Lab ID	Sample ID	Description	A/R
1	21030629	CIC1-21-1		A
2	21030630	CIC1-21-2		A
3	21030631	CIC1-21-3		A
4	21030632	CIC1-21-4		A
5	21030633	CIC1-21-5		A
6	21030634	CIC1-21-6		A
7	21030635	CIC1-21-7		A
8	21030636	CIC1-21-8		A
9	21030637	CIC1-21-9		A
10	21030638	CIC2-21-1		A
11	21030639	CIC2-21-2		A
12	21030640	CIC2-21-3		A
13	21030641	CIC2-21-4		A
14	21030642	CIC2-21-5		A
15	21030643	CIC2-21-6		A
16	21030644	CIC2-21-7		A
17	21030645	CIC2-21-8		A
18	21030646	CIC2-21-9		A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Federal Express				

Office Use Only	Print Name	Signature	Company	Date	Time
Received by	Fatima Khan		NVL	3/3/21	1025
Analyzed by	Nick Ly		NVL	3/10/21	
Results Called by					
☐ Faxed ☐ Emailed					

Special Received CC payment -KA
Instructions:

Date: 3/3/2021
 Time: 11:43 AM
 Entered By: Grace Johnson

2103926



ASBESTOS CHAIN OF CUSTODY

Turn Around Time

- ☐ 1 Hour ☐ 24 Hours ☐ 4 Days
☐ 2 Hours ☐ 2 Days ☒ 5 Days
☐ 4 Hours ☐ 3 Days ☐ 10 Days

Please call for TAT less than 24 Hours

Company WSU Tri-Cities
 Address 2710 Crimson Way
Richland, WA 99354
 Phone 509-372-7163

Project Manager Scott Tomren
 Cell () -
 Email stomren@wsu.edu
 Fax () -

Project Name/Number CIC	Project Location Interior walls
--------------------------------	--

- ☐ PCM Air (NIOSH 7400) ☐ TEM (NIOSH 7402) ☐ TEM (AHERA) ☐ TEM (EPA Level II Modified)
☒ PLM (EPA 600/R-93-116) ☐ EPA 400 Points (600/R-93-116) ☐ EPA 1000 Points (600/R-93-116)
☐ PLM Gravimetry (600/R-93-116) ☐ Asbestos in Vermiculite (EPA 600/R-04/004) ☐ Asbestos in Sediment (EPA 1900 Points)
☐ Asbestos Friable/Non-Friable (EPA 600/R-93/116) ☐ Other _____

Reporting Instructions

- ☐ Call () - ☐ Fax () - ☐ Email _____

Total Number of Samples 18

	Sample ID	Description	A/R
1	CIC1-21-1	Off-white drywall material w/ paper and paint	
2	CIC1-21-2	Off-white drywall material w/ paper and paint	
3	CIC1-21-3	Off-white drywall material w/ paper and paint	
4	CIC1-21-4	Off-white drywall material w/ paper and paint	
5	CIC1-21-5	Off-white drywall material w/ paper and paint	
6	CIC1-21-6	Off-white drywall material w/ paper and paint	
7	CIC1-21-7	Off-white drywall material w/ paper and paint	
8	CIC1-21-8	Off-white drywall material w/ paper and paint	
9	CIC1-21-9	Off-white drywall material w/ paper and paint	
10	CIC2-21-1	Off-white drywall material w/ paper and paint	
11	CIC2-21-2	Off-white drywall material w/ paper and paint	
12	CIC2-21-3	Off-white drywall material w/ paper and paint	
13	CIC2-21-4	Off-white drywall material w/ paper and paint	
14	CIC2-21-5	Off-white drywall material w/ paper and paint	
15	CIC2-21-6	Off-white drywall material w/ paper and paint	

	Print Name	Signature	Company	Date	Time
Sampled by	S. Tomren		WSUTC	2/26/2021	1600
Relinquish by	S. Tomren		WSUTC	3/1/2021	1100

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by				3/3/21	10:25 am
Analyzed by					
Called by					
Faxed/Email by					



ASBESTOS CHAIN OF CUSTODY

2103926

Turn Around Time

- | | | |
|----------------------------------|-----------------------------------|--|
| ☐ 1 Hour | ☐ 24 Hours | ☐ 4 Days |
| ☐ 2 Hours | ☐ 2 Days | ☒ 5 Days |
| ☐ 4 Hours | ☐ 3 Days | ☐ 10 Days |

Please call for TAT less than 24 Hours

Company WSU Tri-Cities
Address 2710 Crimson Way
Richland, WA 99354
Phone 509-372-7163

Project Manager Scott Tomren
Cell ()
Email stomren@wsu.edu
Fax ()

Project Name/Number CIC	Project Location Interior walls
☐ PCM Air (NIOSH 7400) ☐ TEM (NIOSH 7402) ☐ TEM (AHERA) ☐ TEM (EPA Level II Modified)	
☒ PLM (EPA 600/R-93-116) ☐ EPA 400 Points (600/R-93-116) ☐ EPA 1000Points (600/R-93-116)	
☐ PLM Gravimetry (600/R-93-116) ☐ Asbestos in Vermiculite (EPA 600/R-04/004) ☐ Asbestos in Sediment (EPA 1900 Points)	
☐ Asbestos Friable/Non-Friable (EPA 600/R-93/116) ☐ Other _____	

Reporting Instructions

☐ Call () ☐ Fax () ☐ Email _____

Total Number of Samples 18

	Sample ID	Description	A/R
1	CIC2-21-7	Off-white drywall material w/ paper and paint	
2	CIC2-21-8	Off-white drywall material w/ paper and paint	
3	CIC2-21-9	Off-white drywall material w/ paper and paint	
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			

	Print Name	Signature	Company	Date	Time
Sampled by	S. Tomren		WSUTC	2/26/2021	1600
Relinquish by	S. Tomren		WSUTC	3/1/2021	1100

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by				3/3/21	10:25am
Analyzed by					
Called by					
Faxed/Email by					